


	GENERAL INFORMATION	SECTION:
		1099
		SHEET:
		1 OF 1
REV_DATE:	SIGNAGE	
04/01/26		

1099

SIGNAGE

CONTAINS

- 1099-09 POLE SIGNAGE
- 1099-10 PRIMARY RISER SIGNAGE
- 1099-12 PADMOUNT EQUIPMENT WARNING DECALS
- 1099-13 1PH PADMOUNT XFMR DECALS
- 1099-14 3PH PADMOUNT XFMR DECALS
- 1099-15A AIR INSULATED SWGR DECALS
- 1099-15B GAS INSULATED SWGR DECALS
- 1099-16 SECTIONALIZING CABINET DECALS
- 1099-17 POLE MOUNTED XFMR DECALS
- 1099-18A 36" PULLBOX TAGGING - 1PH & 3PH
- 1099-18B 18" SERVICE PULLBOX TAGGING - SINGLE & MULTIPLE
- 1099-19 MANHOLE TAGGING - 1PH

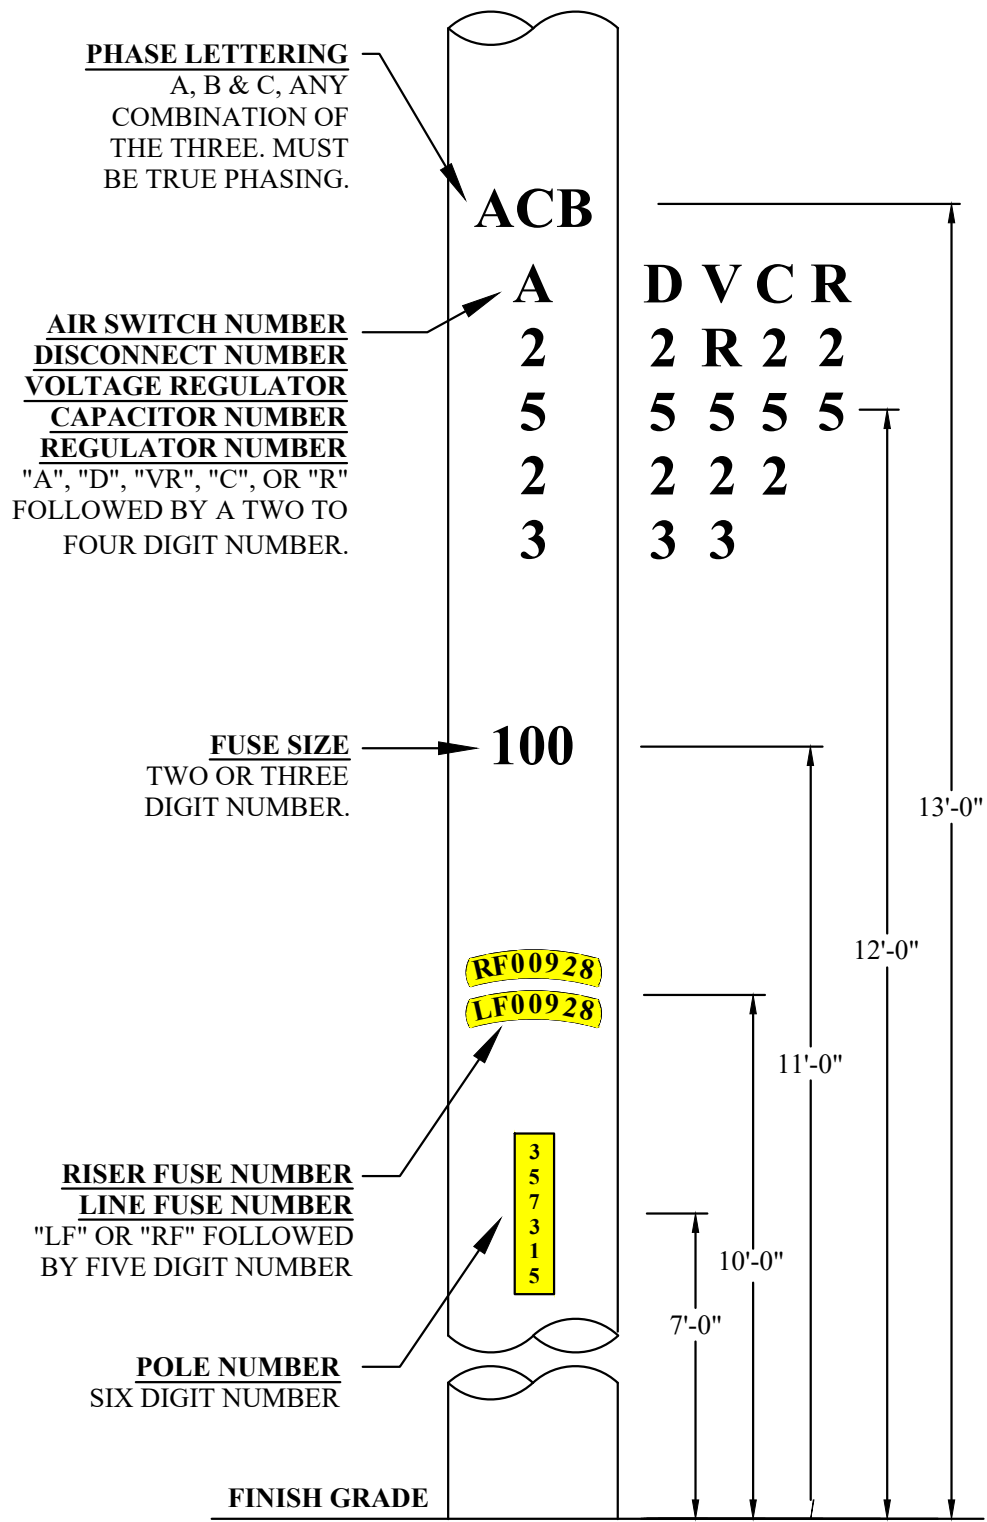

OVERHEAD FED BY UNDERGROUND
 LOCATED UNDER TERMINATIONS.
 (ITEM# 16642)

NESC CLEARANCE REQUIRED
 (AE ITEM# 22781)

OVERHEAD FED BY UNDERGROUND
 (ITEM# 16642)

TWO WAY FEED
 (AE ITEM# 16590)

AIR SWITCH NUMBER DISCONNECT NUMBER
 "A" OR "D" FOLLOWED BY FOUR DIGIT NUMBER.


FUSE SIZE
 TWO OR THREE DIGIT NUMBER.

FUSE TYPE
 ONE OR TWO DIGIT LETTER: "N", "KS", "X", OR "T".

LINE FUSE NUMBER OR RISER FUSE NUMBER
 "LF" OR "RF" FOLLOWED BY FIVE DIGIT NUMBER

POLE NUMBER
 SIX DIGIT NUMBER
 (ITEM# 24954)

FINISH GRADE

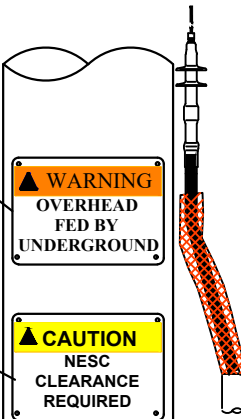

A	D
2	2
5	5
2	2
3	3




25
N

LF00928

3
5
7
3
1
5

PHASE LETTERING
 ANY COMBINATION OF THE THREE LETTERS UNDER TERMINATION. MUST BE TRUE PHASING.

CIRCUIT NUMBERING
 ANY COMBINATION OF THE CIRCUIT NUMBER UNDER TERMINATION. SINGLE PHASE ONLY.

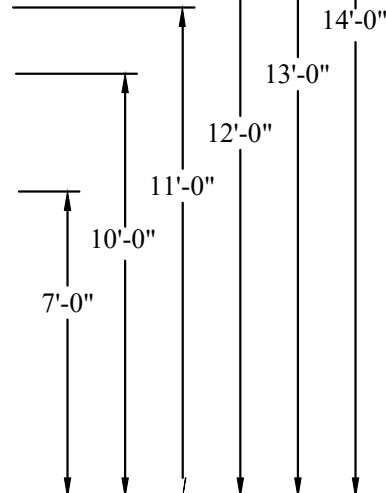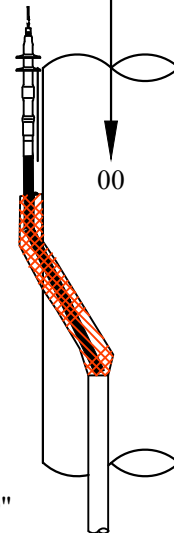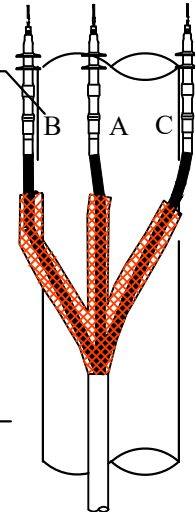

Black on orange background

Black on orange background

.25" Rcorners x4

10 1/2"

⚠️ **WARNING**

Hazardous voltage.
KEEP OUT!

Can shock, burn or cause death.
 If found damaged or unlocked call:

1-512-322-9100

⚠️ **WARNING**

Underground power cables are located in this area.

Before digging or excavating call 811.

Can shock, burn or cause death.

⚠️ US1 (11/25) U10105WWN-AE-TX25

NOTICE

We need room to work safely on this device. Please keep shrubs and structures 10 feet away from the side with doors and 5 feet from other sides. Clearance from concrete pad.

Obstructions may be damaged or removed during service restoration or maintenance.

© 2014 UTILITY SYSTEMS, INC.

AVISO

Necesitamos espacio para trabajar con seguridad en este dispositivo. Por favor sigue arbustos y estructuras 10 pies lejos del lado con puertas y 5 pies de otros lados. Espacio libre de la plataforma de hormigón.

Las obstrucciones pueden dañarse o eliminado durante el servicio restauración o mantenimiento.

White on blue background

10"

⚠️ **¡ADVERTENCIA!**

Voltaje peligroso adentro.
¡NO ACERCARSE!

Puede electrocutar, quemar o causar la muerte.
 Si encontrado dañado o abierto, llame a:

1-512-322-9100

⚠️ **¡ADVERTENCIA!**

Cables subterráneos localizados en esta área.

Antes de cavar o excavar llame 811.

Puede electrocutar, quemar o causar la muerte.

"3-IN-1 WARNING" DECAL
 DECAL, 3 IN 1 FOR ELECTROCUTION HAZ CLEARANCE 1 CALL
 AE ITEM # 17863

white on red background

.6"

.37"

.48"

.176"

1/4" round corners

10.75"

⚠️ **DANGER**

Hazardous voltage.
KEEP OUT!

Will shock, burn or cause death.

If open or unlocked, call:
Austin Energy
1-512-322-9100

⚠️ US1 UB2107DP-ES-AE-TX (12/23)

Date Stamp

.875"

⚠️ **PELIGRO**

Voltaje peligroso.
¡NO ENTRAR!

Producirá choques eléctricos, quemaduras, o causará la muerte.


Si abre o desatrancó, llama:
Austin Energy
1-512-322-9100

5.25"


All other graphics print black on white background.

DANGER DECAL FOR PADMOUNT EQUIPMENT (INTERNAL)
 DECAL, DANGER FOR PD MT EQUIP INTERNAL
 AE ITEM # 25016
 © CITY OF AUSTIN DBA AUSTIN ENERGY 2026


1PH PADMOUNT XFMR - EXTERIOR

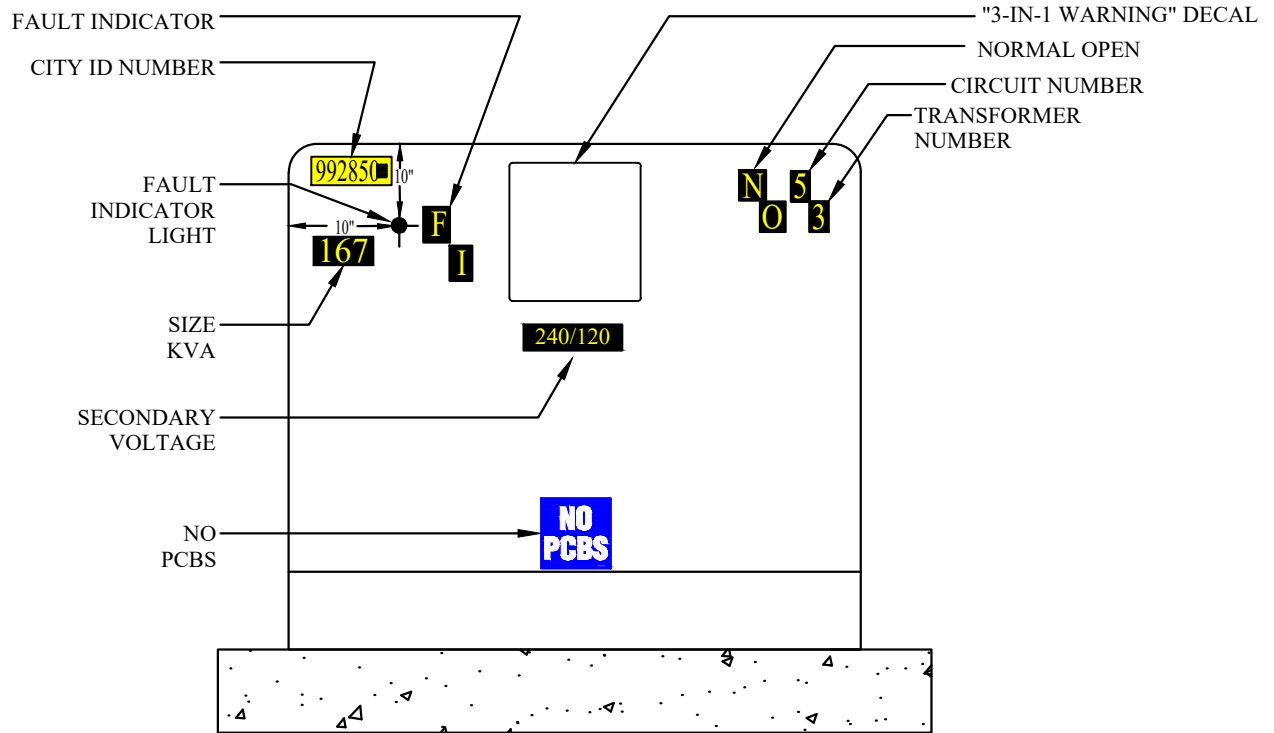

1PH PADMOUNT XFMR - INTERIOR

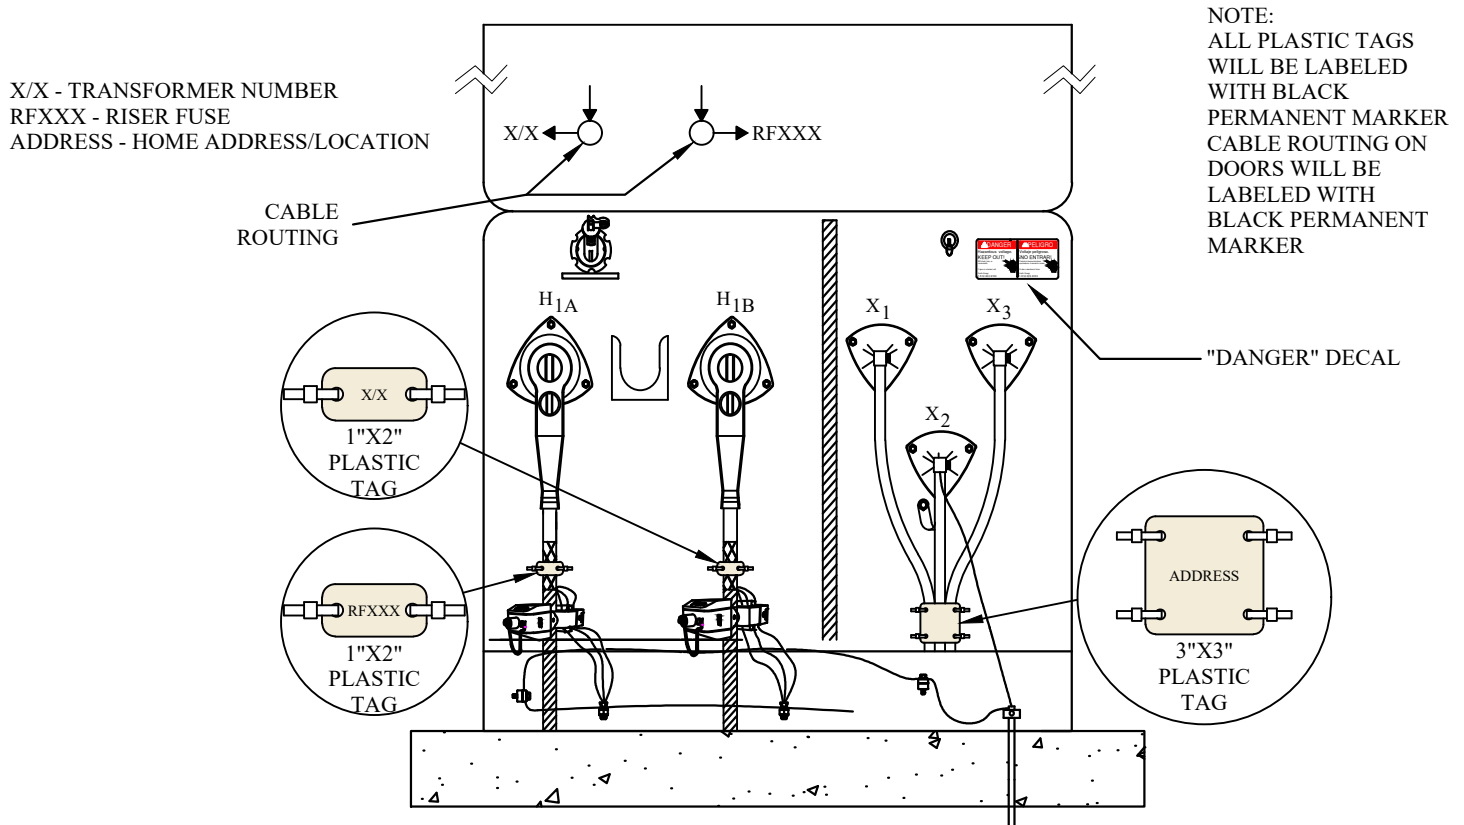


3PH PADMOUNT XFMR - EXTERIOR



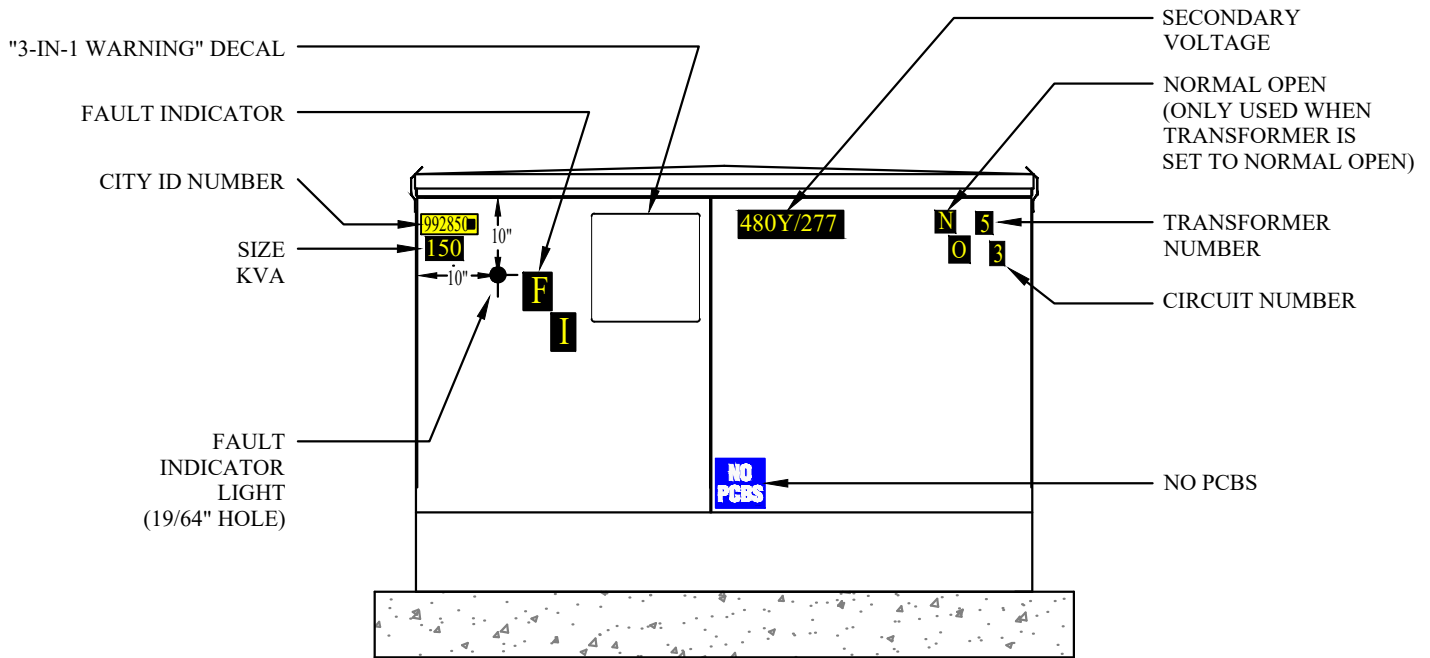


3PH PADMOUNT XFMR - INTERIOR

X/X - TRANSFORMER NUMBER
RFXXX - RISER FUSE
ADDRESS - HOME ADDRESS/LOCATION



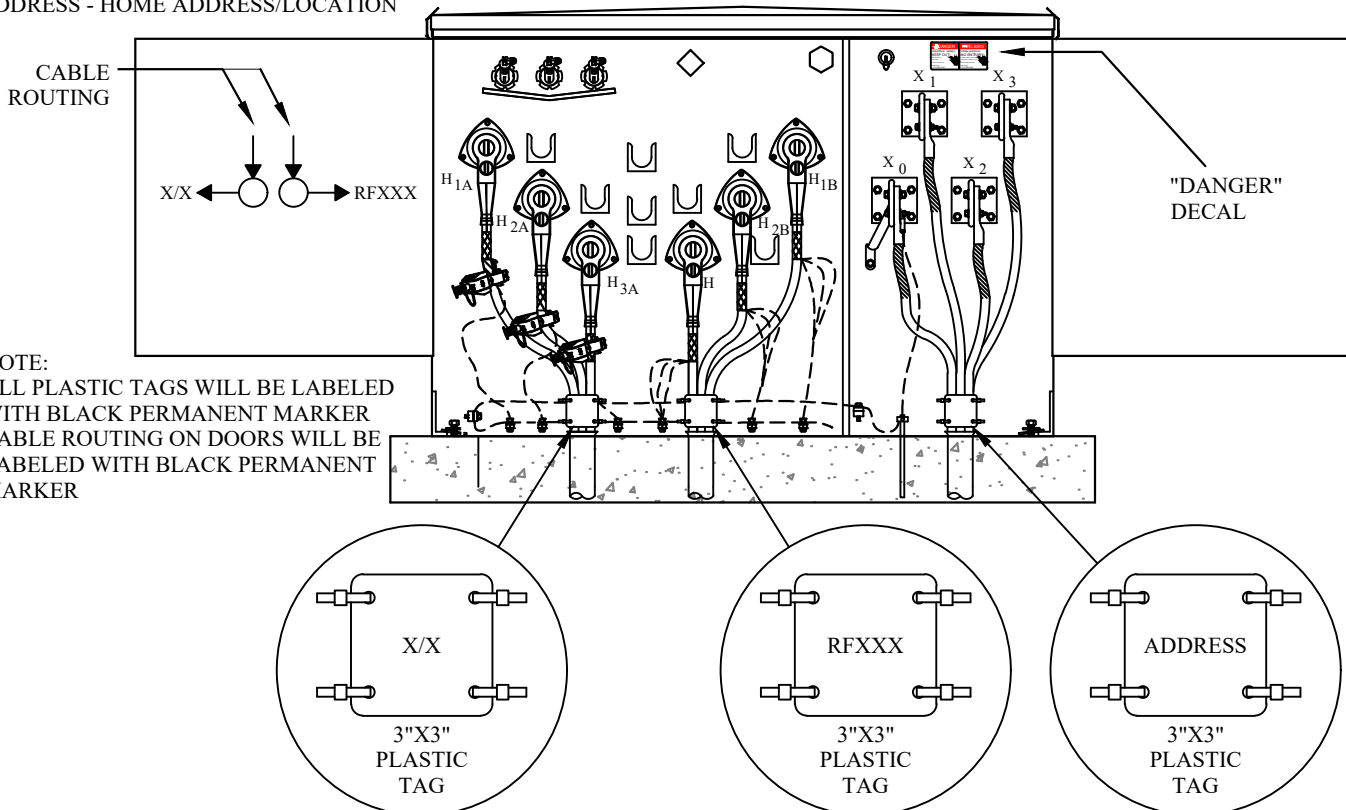


GENERAL INFORMATION
SIGNAGE
AIR INSULATED SWGR DECALS

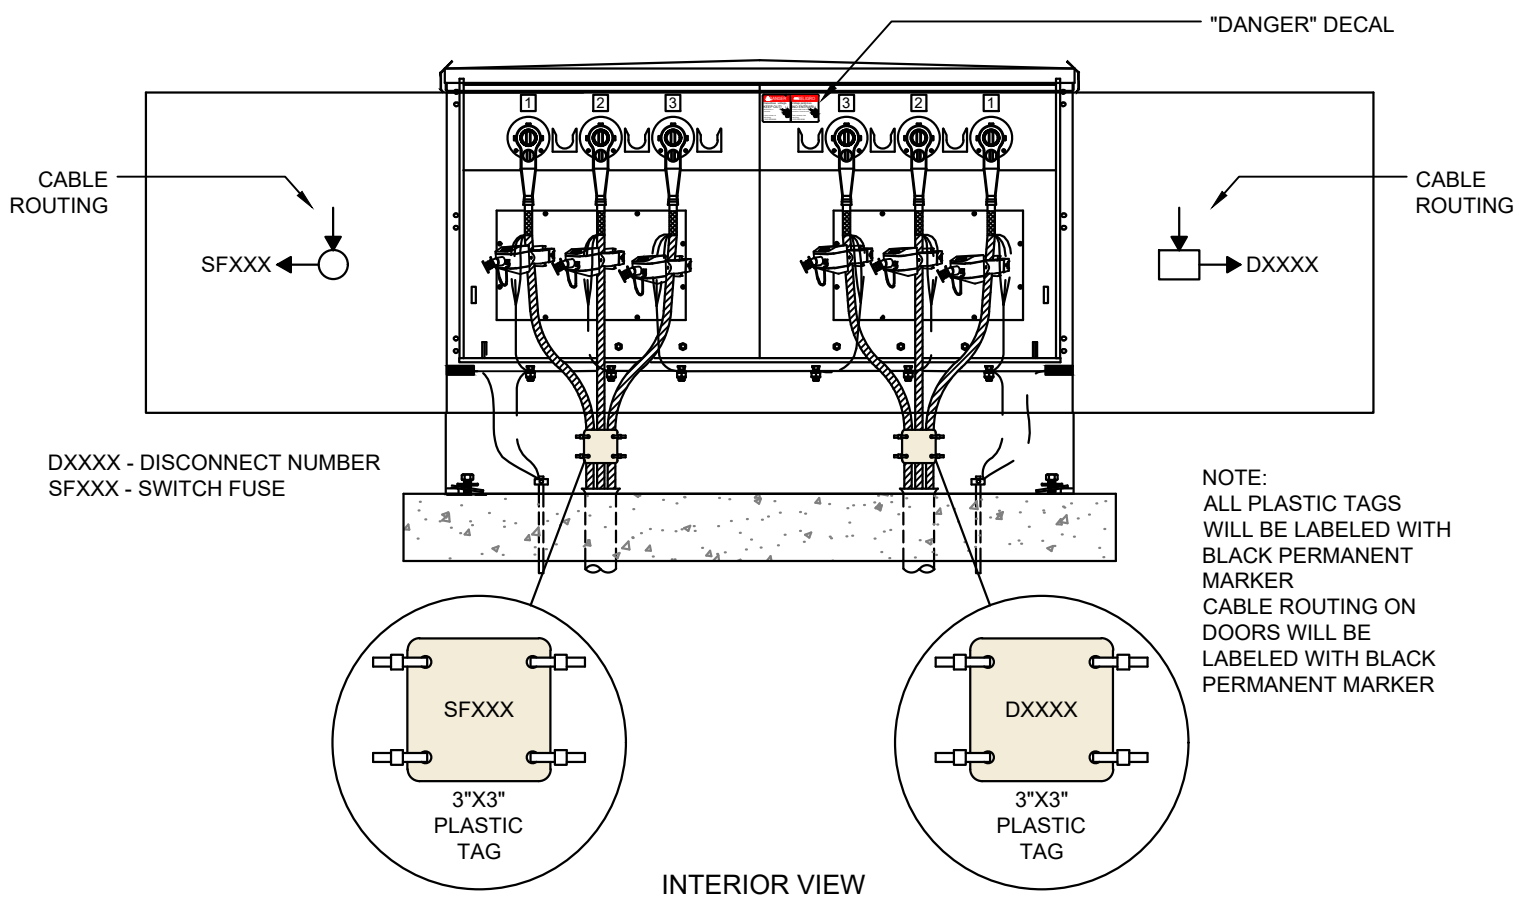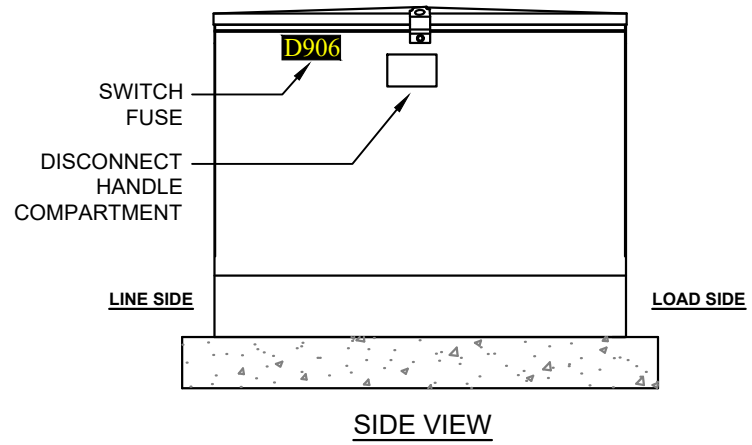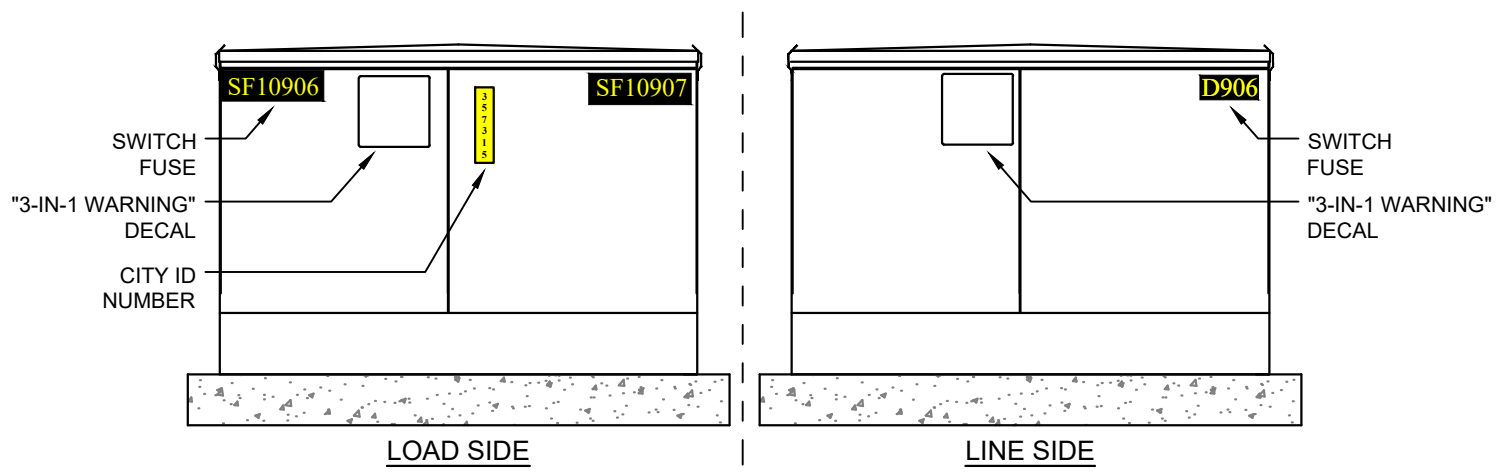








REV_DATE:

04/01/26

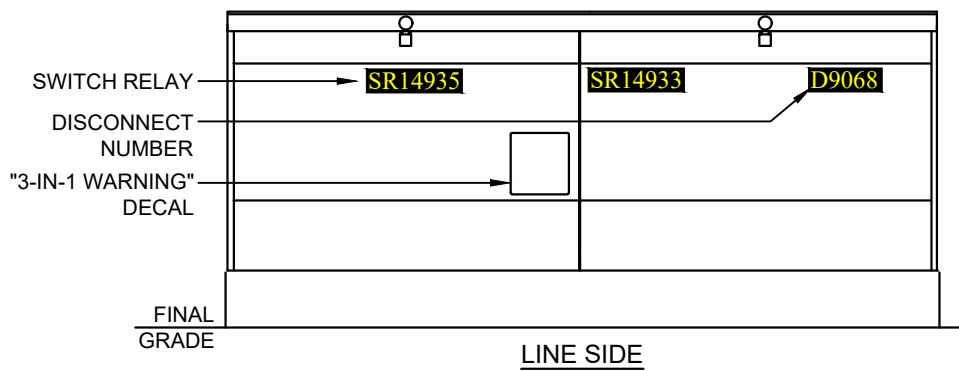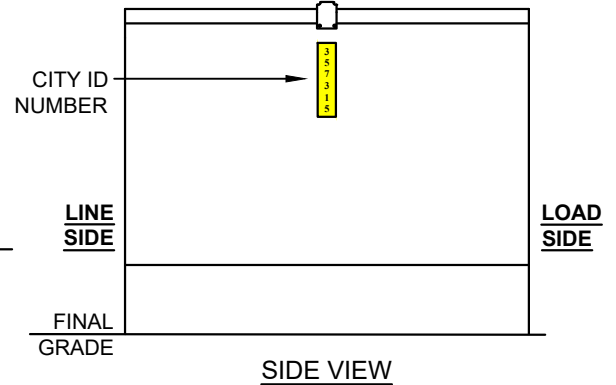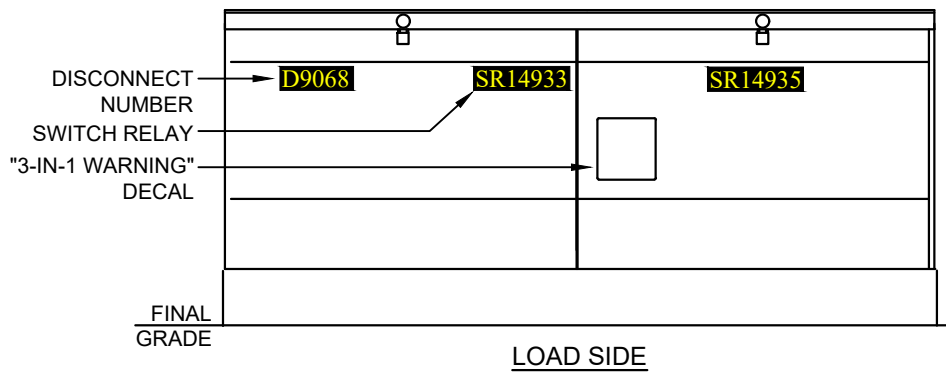

NOTE:
ALL PLASTIC TAGS
WILL BE LABELED WITH
BLACK PERMANENT
MARKER
CABLE ROUTING ON
DOORS WILL BE
LABELED WITH BLACK
PERMANENT MARKER

X-X - XFMR NUMBER
 RFXXX - RISER FUSE
 DXXXX - DISCONNECT
 SFXXX - SWITCH FUSE

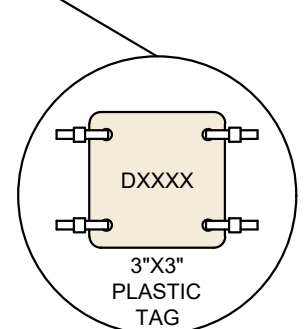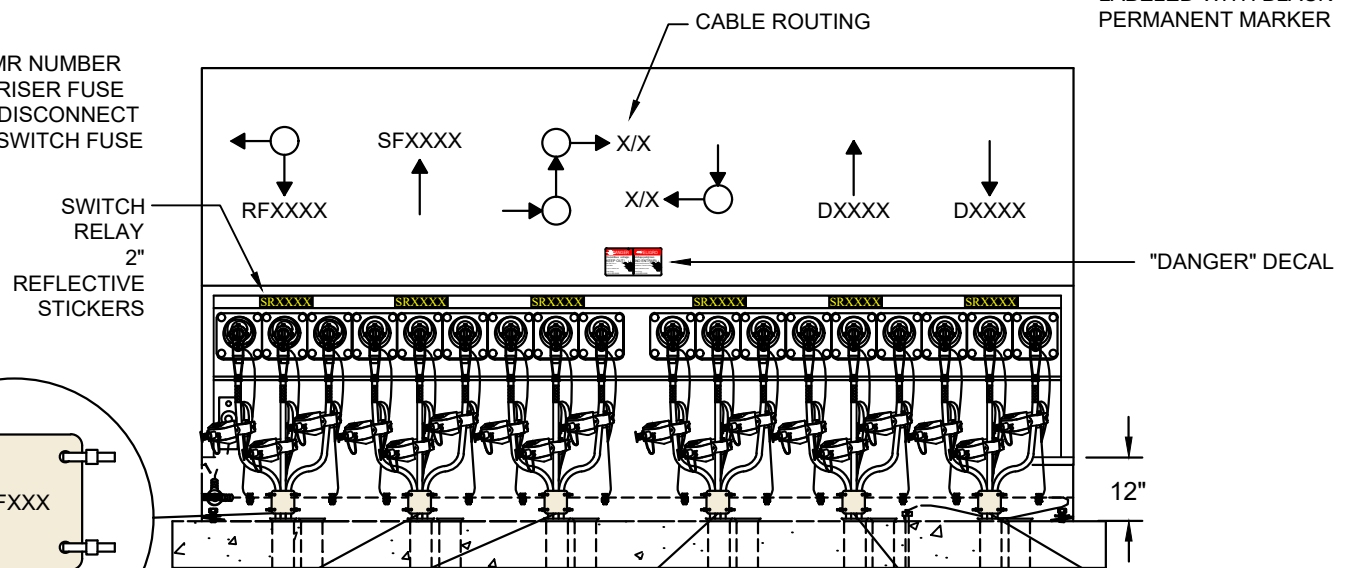


INTERIOR VIEW

SECTIONALIZING CABINET - EXTERIOR

CURCUIT NUMBER
"CKT" FOLLOWED BY A
ONE, TWO, OR THREE
DIGIT NUMBER.


"3-IN-1 WARNING"
DECAL

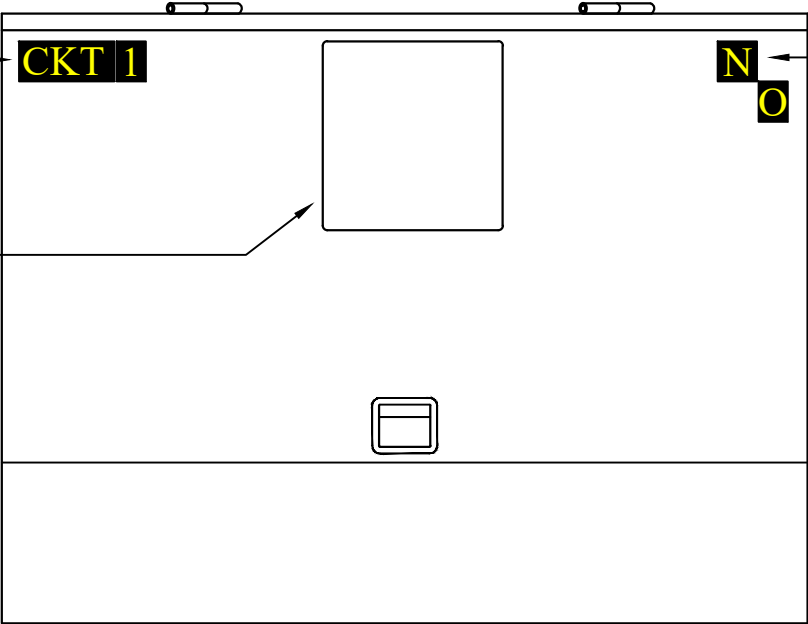


NORMALY OPEN
ONLY USED WHEN
SECTIONALIZING
CABINET IS SET TO
NORMALLY OPEN.


SECTIONALIZING CABINET - INTERIOR

"DANGER" DECAL

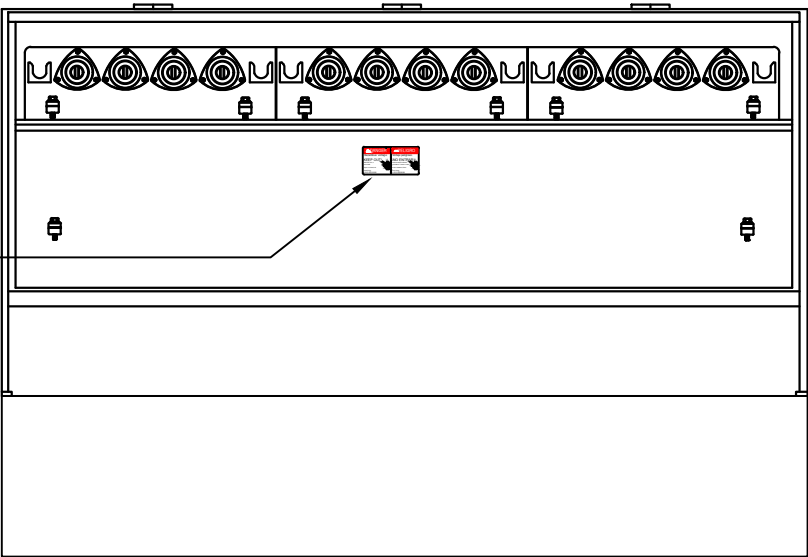


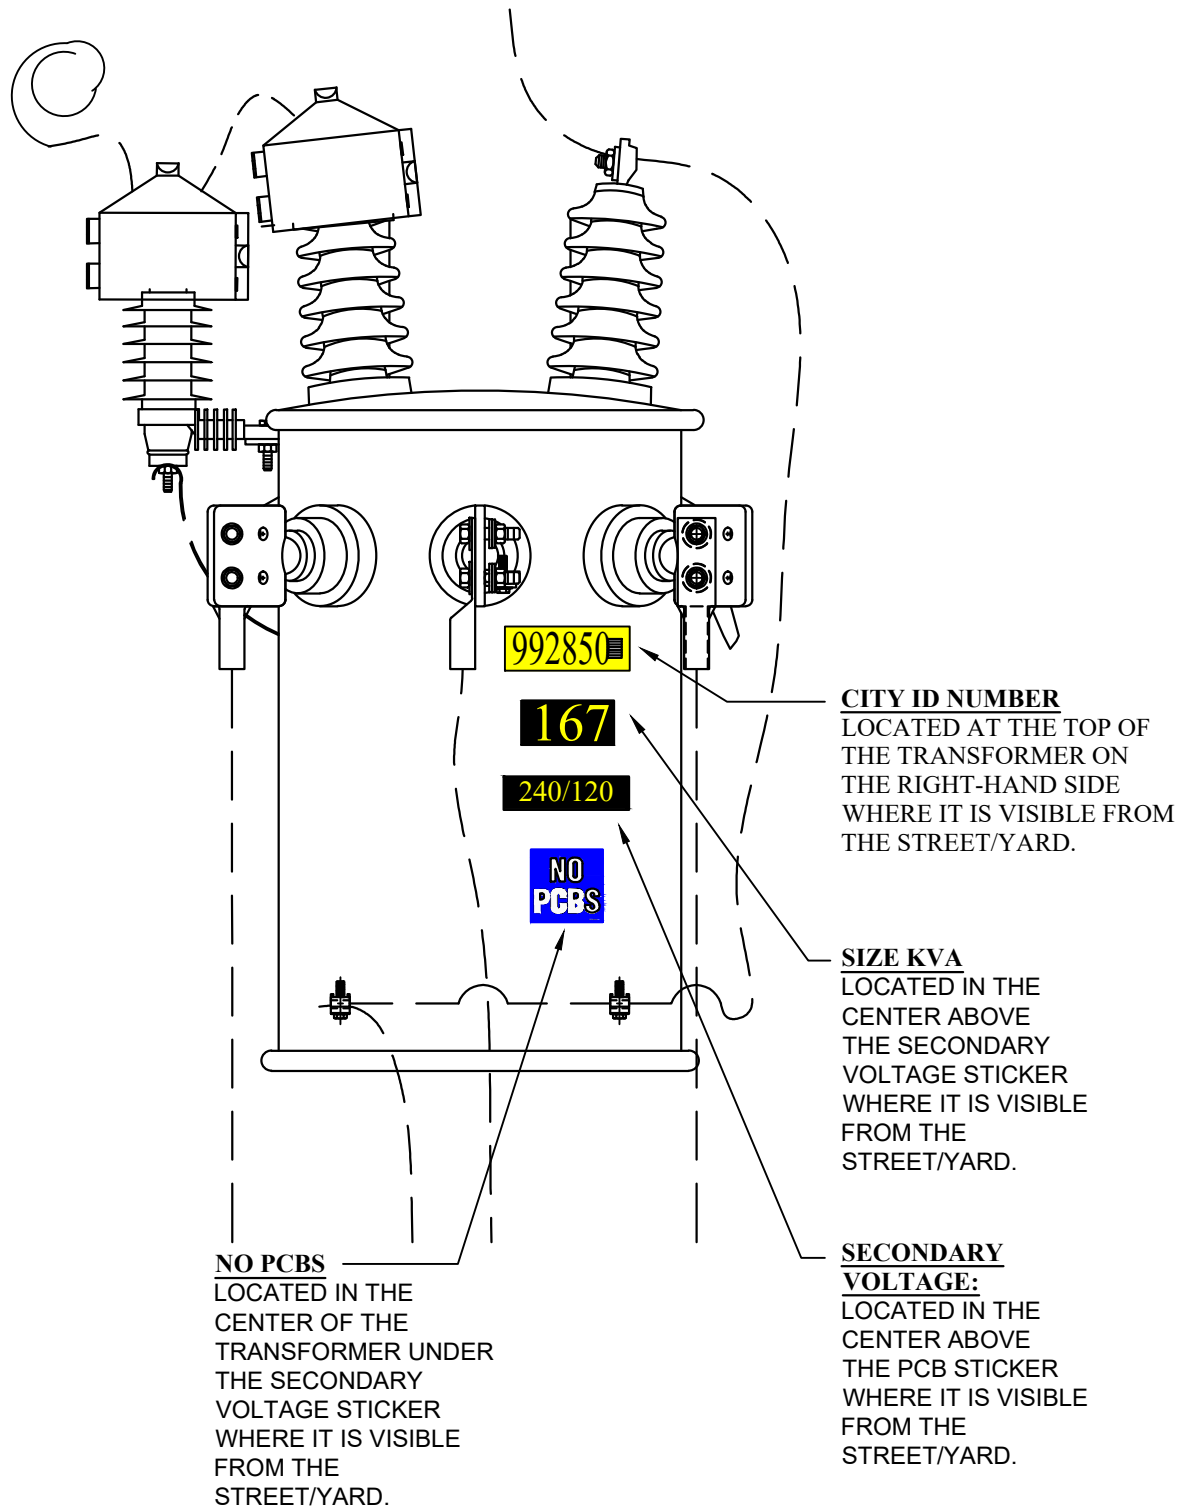


GENERAL INFORMATION
SIGNAGE
36" PULLBOX TAGGING - 1PH & 3PH

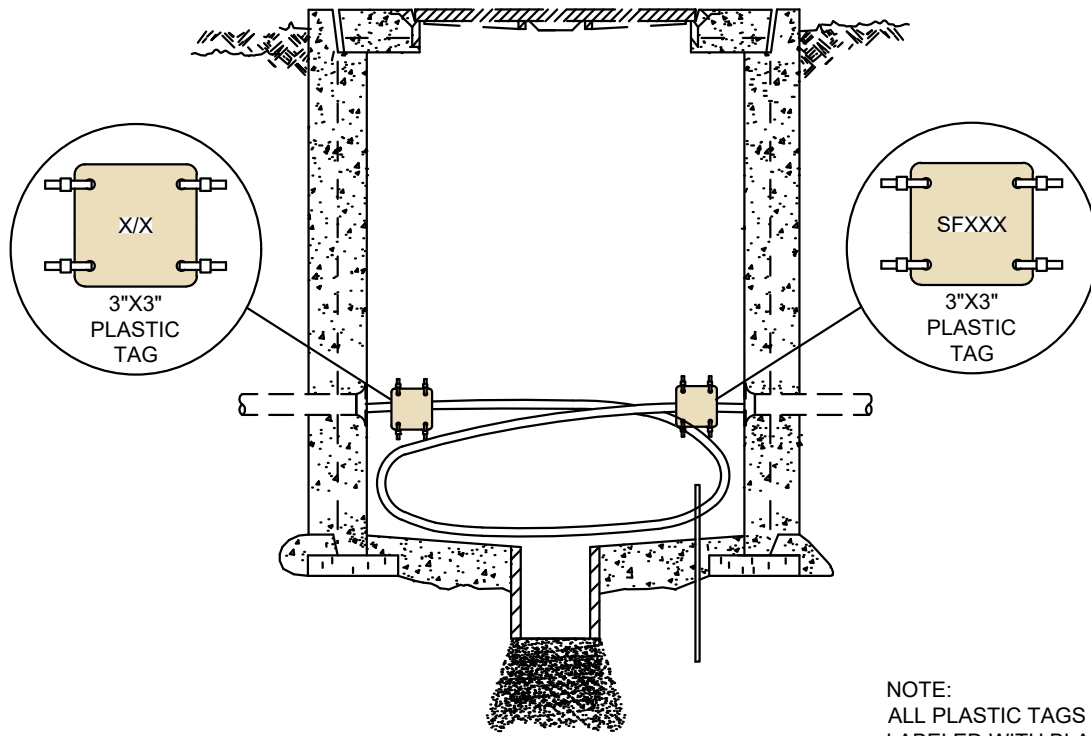

36" PULLBOX
SINGLE PHASE URD (PRIMARY)

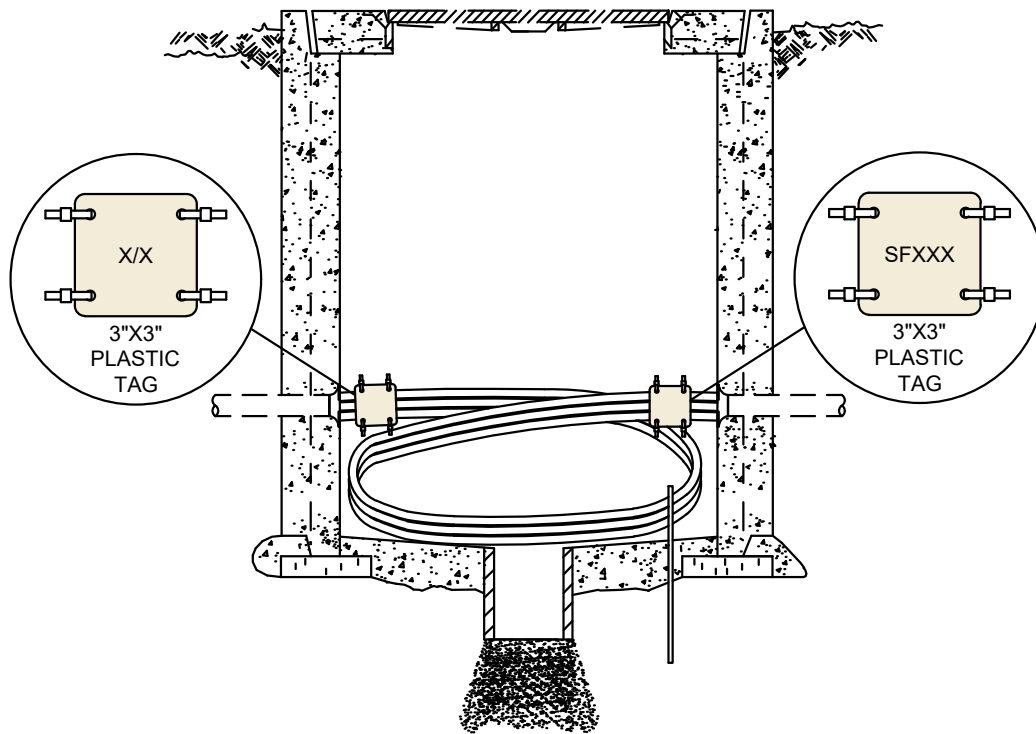

36" PULLBOX
THREE PHASE URD (PRIMARY)

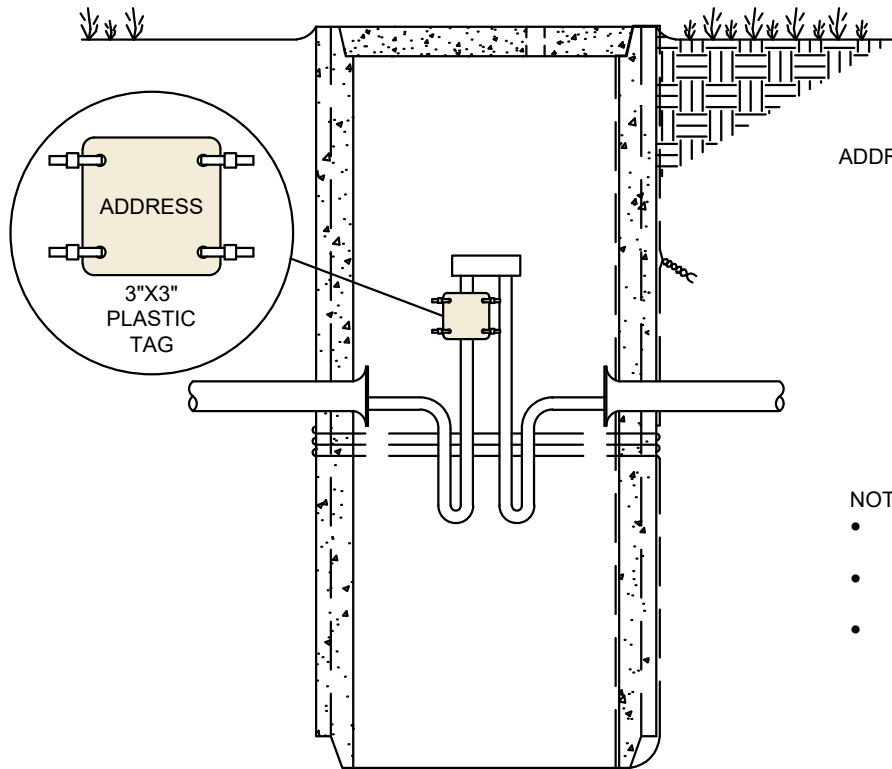


ADDRESS - HOME ADDRESS OR LOCATION

NOTES:

- ALL PLASTIC TAGS WILL BE LABELED WITH BLACK PERMANENT MARKER.
- INSTALL TAG ON NEUTRAL WIRE OF SERVICE, BELOW THE CONNECTOR.
- 3"X3" PLASTIC TAG FOR SERVICE WIRE 600V OR LESS.

18" SERVICE BOX
SINGLE SERVICE

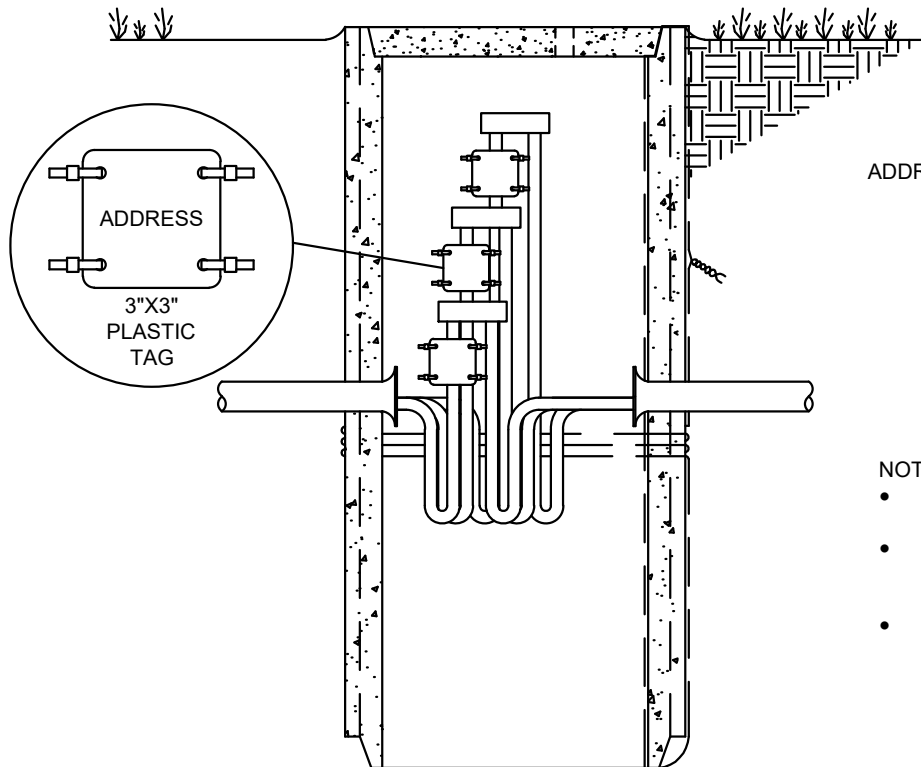


ADDRESS - HOME ADDRESS OR LOCATION

NOTES:

- ALL PLASTIC TAGS WILL BE LABELED WITH BLACK PERMANENT MARKER.
- INSTALL TAG ON NEUTRAL WIRE OF SERVICE, BELOW THE CONNECTOR, FOR EACH SERVICE.
- 3"X3" PLASTIC TAG FOR SERVICE WIRE 600V OR LESS.

18" SERVICE BOX
MULTIPLE SERVICE

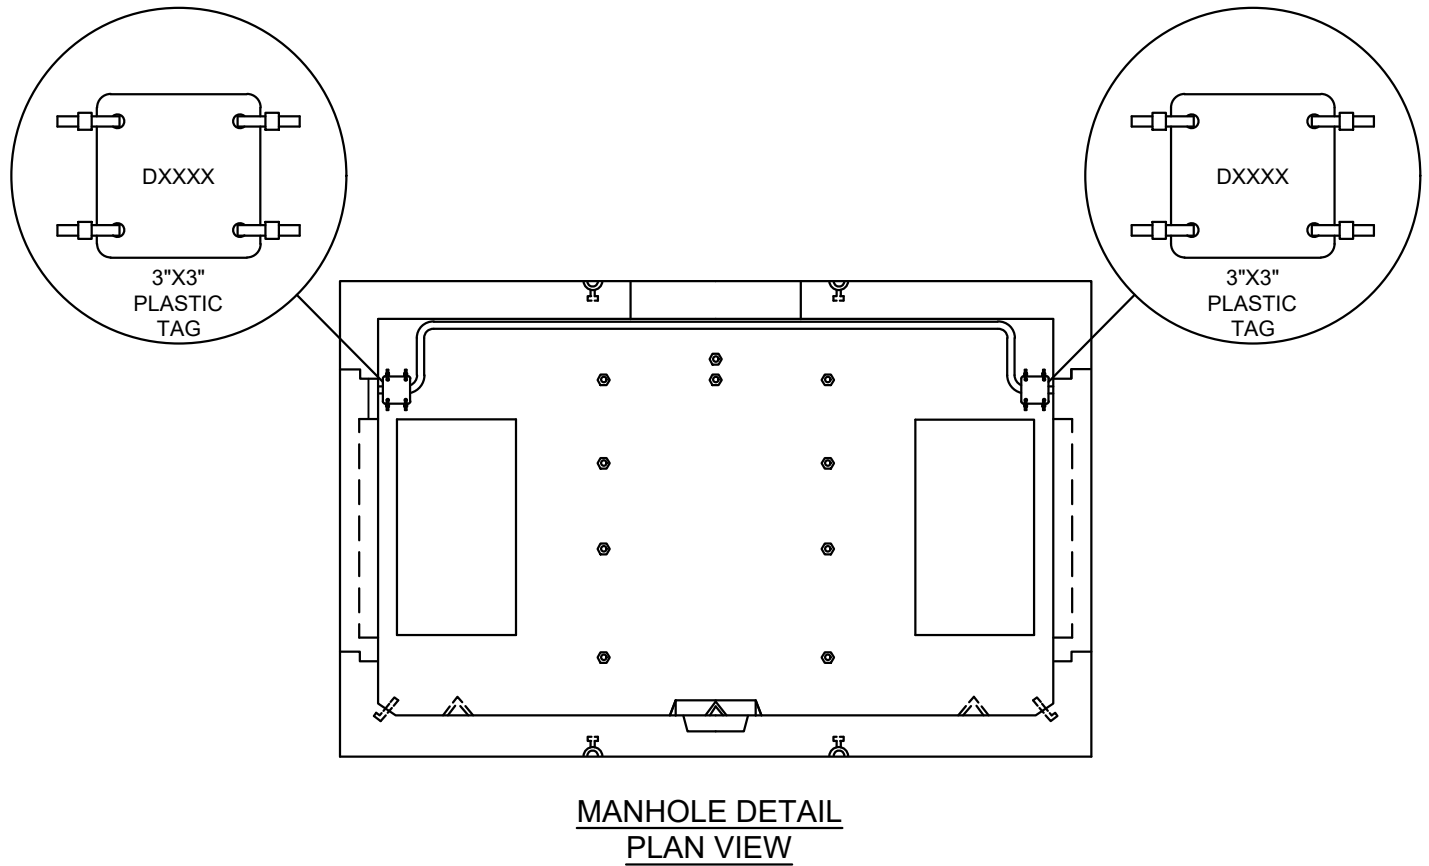

NOTES:
ALL PLASTIC TAGS WILL BE LABELED WITH BLACK PERMANENT MARKER.