


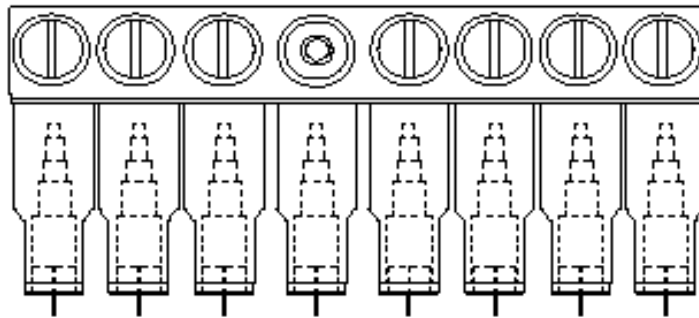


List of Approved Terminations


Manufacturer	MFG Part #	Website Link
CMC	SSBC350-4SI	LINK
T&B	RAB4C	LINK
UTILCO	PED-350SSP	LINK
CMC	SSBC750-4I	LINK
UTILCO	PED4-750SSP	LINK

The manufacturer part number may change by the manufacturer, please refer to the manufacturer for any updated part number and use the spec sheets provided for reference. In any case of issues with these terminations please email us at aedisconnectprogram@austinenergy.com

1245-21	CONDUCTORS AND HARDWARE	
Sheet 1 of 2	OH AND UG CONNECTORS	
Rev: 08/01/20	CONNECTOR URD SEC 4, 6 AND 8 POSITION	




8 WAY CONNECTOR

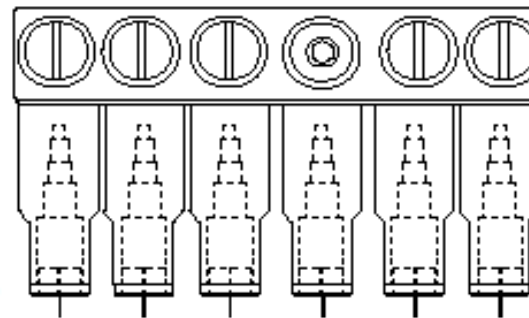

6 WAY CONNECTOR

NOTES:

1. EACH TAP POSITION IS PROVIDED WITH SEALED WATERTIGHT CAPS.
2. KEEP THESE CAPS ON ALL UNUSED TAP POSITIONS. SEAL TAP POSITIONS WITH CABLES WITH THE FORCE-FIT SLEEVES PROVIDED WITH THE MOLE TAP KITS.
3. PRIOR TO INSTALLING ALUMINUM CONDUCTOR CONNECTORS, CLEAN THE CONDUCTOR WITH A WIRE BRUSH TO REMOVE OXIDES.
4. IMMEDIATELY APPLY A NON-GRIT INHIBITOR TO THE CONTACT SURFACE OF THE CONNECTOR. CONNECTORS GENERALLY COME WITH INHIBITOR APPLIED AT THE FACTORY.

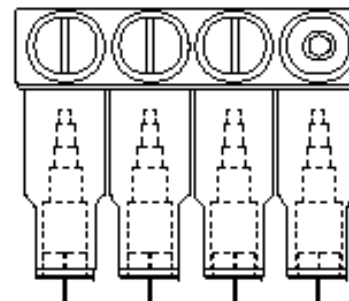

4 WAY CONNECTOR

1245-21-10 350 MCM TO #12 6-WAY 600V INSULATED
 1245-21-20 350 MCM TO #12 4-WAY 600V INSULATED
 1245-21-30 750 MCM TO #2 8-WAY 600V INSULATED
 1245-21-35 750 MCM TO #2 4-WAY 600V INSULATED